




Consolidation Test

ASTM D2435

Job No.:	Boring: SB-01	Run By: MD
Client:	Sample:	Reduced: PJ
Project:	Depth, ft.: 12.5-14.5(Tip-5")	Checked: PJ/DC
Soil Type: Black CLAY w/ organics		Date:

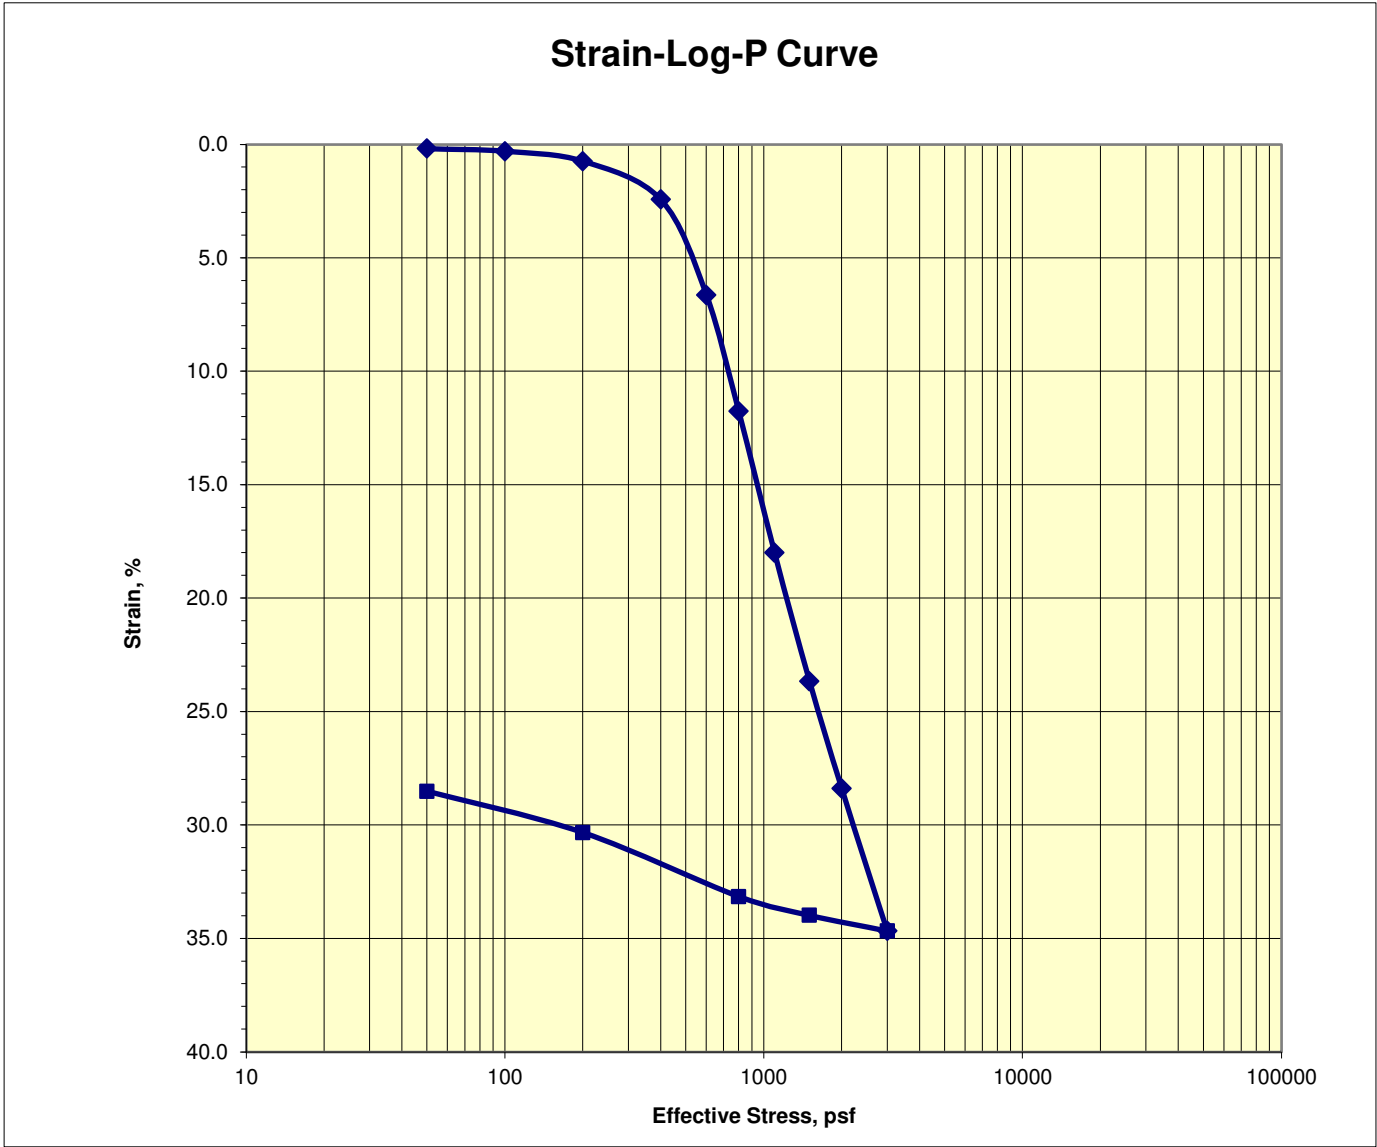

Assumed Gs	2.753	Initial	Final
Moisture %:		139.5	90.6
Dry Density, pcf:		34.9	49.2
Void Ratio:		3.928	2.494
% Saturation:		97.7	100.0

Remarks: